
Document No. 129-420 December 13, 2004

OpenAir™ External Auxiliary Switch

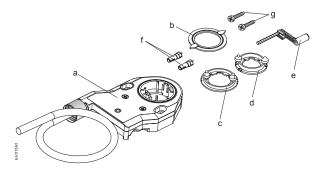

- a. External dual auxiliary switch
- b. Position indicator
- c. GCA/GBB/GIB position adapter
- d. GMA/GEB position adapter
- e. 3 mm hex key
- f. Plastic mounting adapter inserts (2)
- g. Threaded M5 × 25 screws (2)

Figure 1. External Auxiliary Switch Kit Contents.

Product Description

The OpenAir External Auxiliary Switch (EAS) provides switch functionality for standard model damper actuators with easy installation for in-service units.

Product Number

ASC77.2U

Specifications

Dual Auxiliary Switches

AC rating	24 Vac to 250 Vac
	AC 6A resistive
	AC 2 FLA, 12 LRA
DC rating	12 Vdc to 30 Vdc
Do fatility	DC 2A
Insulation system	Double insulated
Switch range	
Switch A	0° to 90° with 5° intervals
Recommended usage	0° to 45°
Switch B	0° to 90° with 5° intervals
Recommended	45° to 90°
usage	
Switching hysteresis	2°
	2° UL listed to UL 873
Š	UL listed to UL 873 cUL certified to Canadian
Š	UL listed to UL 873 cUL certified to Canadian Standard C22.2
Switching hysteresis	UL listed to UL 873 CUL certified to Canadian Standard C22.2 No. 24-93
Š	UL listed to UL 873 cUL certified to Canadian Standard C22.2 No. 24-93 Electromagnetic
Switching hysteresis	UL listed to UL 873 cUL certified to Canadian Standard C22.2 No. 24-93 Electromagnetic compatibility 89/336/EEC
Switching hysteresis	UL listed to UL 873 cUL certified to Canadian Standard C22.2 No. 24-93 Electromagnetic compatibility 89/336/EEC Low voltage directive
Switching hysteresis Agency certification	UL listed to UL 873 cUL certified to Canadian Standard C22.2 No. 24-93 Electromagnetic compatibility 89/336/EEC Low voltage directive 73/23/EEC
Switching hysteresis	UL listed to UL 873 CUL certified to Canadian Standard C22.2 No. 24-93 Electromagnetic compatibility 89/336/EEC Low voltage directive 73/23/EEC Threaded 1/2-inch
Switching hysteresis Agency certification	UL listed to UL 873 cUL certified to Canadian Standard C22.2 No. 24-93 Electromagnetic compatibility 89/336/EEC Low voltage directive 73/23/EEC

Warning/Caution Notations

WARNING:	Â	Personal injury/loss of life may occur if you do not follow the procedures as specified.
CAUTION:	4	Equipment damage, or loss of data may occur if you do not follow the procedures as specified.

Required Tools

Phillips screwdrivers No. 2 for screws, No. 1 for adjustment

Expected Installation Time

15 minutes

Prerequisites



CAUTION:

Remove power from in-service damper actuator before installing external auxiliary switch.



WARNING:

Do not open the external auxiliary switch.




Figure 2. NEMA Type 3R Rating Only With Use of Weather Shield.

Installation

New Actuators, Remove Pre-load




Figure 3. Determine Actuator Model and Orientation.

NOTE: For in-service actuators, skip *Removing Preload*. For new actuators, remove the factory-installed 5° pre-load.

Removing Preload

Before the External Auxiliary Switch can be installed on a new, out-of-the-box actuator, you must remove the factory-installed preload.

New Non-Spring Return Actuators

- 1. Insert shaft adapter at position A (See Figure 4).
- 2. Press the manual override button and move the shaft adapter counterclockwise until actuator reaches the internal stop (actuator will not move past this point).
- Remove the shaft adapter and manually reinstall it against the external end stop at position B (See Figure 4).
- 4. Proceed with EAS installation.




Figure 4. Insert Shaft Adapter at Position A.

New Spring Return Actuators

 Without the shaft adapter installed, using the hex wrench, wind the manual override one full revolution and release the wrench (See Figure 5). The actuator will return to the 0° position and the preload is now removed.




Figure 5.

Manually install the shaft adapter against the external stop on the left end of the actuator. (See position B in Figure 4.)

Removing Factory Pre-load from New SR Actuator.

Preparing the Actuator Shaft Adapter

- Remove the position indicator from an in-service actuator.
- 2. Determine the appropriate position adapter ring (See Figure 1).
- Align and snap the three open notches on the edge of the EAS position adapter ring in place over the three raised stubs on the actuator shaft adapter. (See Figure 6).




Figure 6. Attaching the EAS Position Adapter Ring.

Short shaft applications

NOTE: The short shaft adapter is included in the packing box with the shaft adapter.

With the short shaft adapter in place, align the notch of the EAS over the protruding tab on the position adapter ring and secure in place. (See Figure 7).




Figure 7. Attaching EAS to GCA/GIB/GBB Shaft Adapter.

Preparing the EAS for Mounting

- 2. On the back of the EAS, push the plastic inserts into the mounting holes. (See Figure 8 and Figure 9).
- 3. Mount the position indicator on the face of the EAS (See Figure 8 step 2 and Figure 9, step 2).




Figure 8. For GMA/GEB Actuators, Use Top Screw Holes.




Figure 9. For GCA, GBB, GIB Actuators, Use the Bottom Screw Holes.

Mounting External Auxiliary Switch to Actuator

1. Nest the alignment peg of the EAS position adapter ring into the notch (See Figure 10).

The EAS lies flush against the face of the actuator.

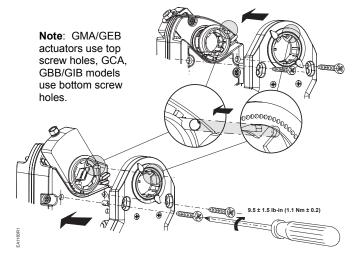


Figure 10. Bringing the EAS and the Actuator together.

2. Secure the EAS in place with the M5×25 screws provided. (See Figure 10).



CAUTION:

The EAS should not shift when it is correctly installed firmly against the face of the actuator.

The installation is complete.

Manual Override

NOTE: When EAS is installed, you can still access the manual override capability as shown in Figure 11.

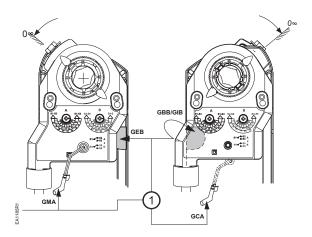


Figure 11. Manual Override.

Auxiliary Switches



CAUTION:

There should be no load on the actuator when setting the auxiliary switches.

Setting the Switches

With the actuator in the full-closed (0°) position, press in and turn with a Phillips screwdriver to the desired setting. Release pressure to set the switch. The switch is now set.




Figure 12. Press In, Turn to Adjust, Release to Set Switch.




Figure 13. Example of Switches Set to 5° and 85°.

Wiring



WARNING:

Do not mix operations. Apply only line voltage or only Class 2 voltages to the switching outputs of both auxiliary switches A and B.




Figure 14. Wiring Diagram.

Wiring Designation

Wire Code	Color	Switch - Function
S1	Gray/red	A Input
S2	Gray/blue	A – NC
S3	Gray/pink	A – NO
S4	Black/red	B Input
S5	Black/blue	B – NC
S6	Black/pink	B – NO

Dimensions

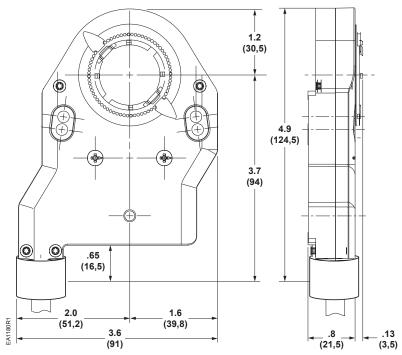


Figure 15. External Auxiliary Switch Dimensions in Inches (mm).

Information in this publication is based on current specifications. The company reserves the right to make changes in specifications and models as design improvements are introduced. OpenAir is a trademark of Siemens Building Technologies, Inc. Other product or company names mentioned herein may be the trademarks of their respective owners. © 2004 Siemens Building Technologies, Inc.