




IG4000 Universal Replacement Kit

Kit content

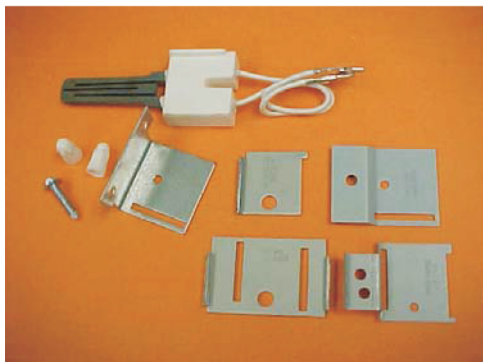

Safe Installation Procedure

1. Disconnect electrical power and gas supply to appliance or furnace and remove HSI igniter.
2. Cut the 2 wires of the burnt-out igniter 3-4 inches from ceramic block.
3. Compare the old ceramic block with the new parts in kit and select the appropriate metal bracket to best match the original igniter. See drawings shown below.
4. Connect existing wires to the new igniter and use the 2 ceramic wire nuts to complete the connection. Ensure that the 2 wire nuts are tightly secured for proper electrical connection.
5. Re-install the new igniter in the reverse order of removal.
6. Test the appliance or furnace several times for proper ignition.


Warranty is for burnt out only

DO NOT USE THIS IGNITER FOR ANY OTHER APPLICATION

Original



Replacement

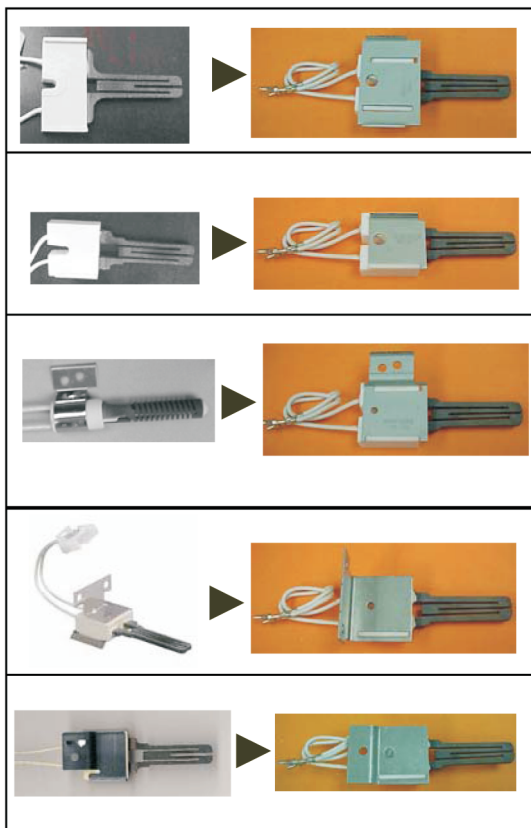

Amana	Icp/Heil/	Rheem Rudd	Norton
10735002	Arco Air	62-22868-93	101M
Arco Air	Comfortmaker	62-22441-01	201D
See ICP	Tempstar	62-22868-82	201K
Armstrong	Keeprite	Roberts-Gordon	201L
38322B001	109604	90434300	201M
Clare Bros.	1096047	90436600	201P
C238	1096048	Superior	201W
C238-1	1009604	Fireplace	271D
Coleman/Evcon	1001344	94851	271M
14740511	1380680	Trane	271N
14740512	1148245	3400339P01	271NM
Detroit/	Integra	B340039P01	271P
Brant Radiant	6905032	B12996P01	271R
201D	3260618	B144676P01	271RS
DMO/Olsen	Johnstone	B144676P02	271W
ECR Ind.	L37-699	B138196P01	Robertshaw/
26789	L37-700	IGN21	Uniline
20834	L37-812	IGN23	41-238
Dornback	L37-814	IGN26	41-242
271W	L37-815	IGN28	41-402
Ducane	L37-816	IGN30	41-403
20015201	L.B. White Co	IGN34	41-404
Enerco Tech.	120-07549	Viessmann	41-405
10399	Lennox	9302-093	41-407
Goodman/Janitrol	33J3701	9302-094	41-408
B1172606	Majestic	Wayne Home	41-409
B1193939	75-92-104	Equipment	41-410
B1401009	75-92-105	62821-001	41-412
B1401015	Metzger	62821-002	41-414
B1401018	201N	Weil McLain	41-1090
John Woods/	201W	29074	White -Rodgers
GSW P.V.	Mor-Flo	511-330-139	767A-301
86483	3200618	511-330-193	767A-303
H.B. Smith	Nordyne/Tappan	511-330-190	767A-306
50018	Frigidaire/Philco	Williamson	767A-310
Hupp Ind	Intertherm/Miller	09050	767A-311
9050	903110	York	767A-350
Raypak	105141000	025-32626-000	767A-353
600915	RH622286893	473-12509-001	767A-354
	632-0770	373-09154-700	767A-357
	632-0880	025-27774-000	767A-361
	902661	025-29043-000	767A-364
	902694	025-29050-000	767A-365
	903758	025-27766-000	767A-366
	632-3811	025-30277-000	767A-370
	632-3540	025-32638-002	767A-371
		025-32625-000	767A-372
		025-31801-000	
		373-05342-700	

Sealed Unit Parts Co., Inc.

2230 Landmark Place
Allenwood, NJ 08720 USA
Phone: 732-223-6644 • Fax: 732-223-1617
www.supco.com • info@supco.com